



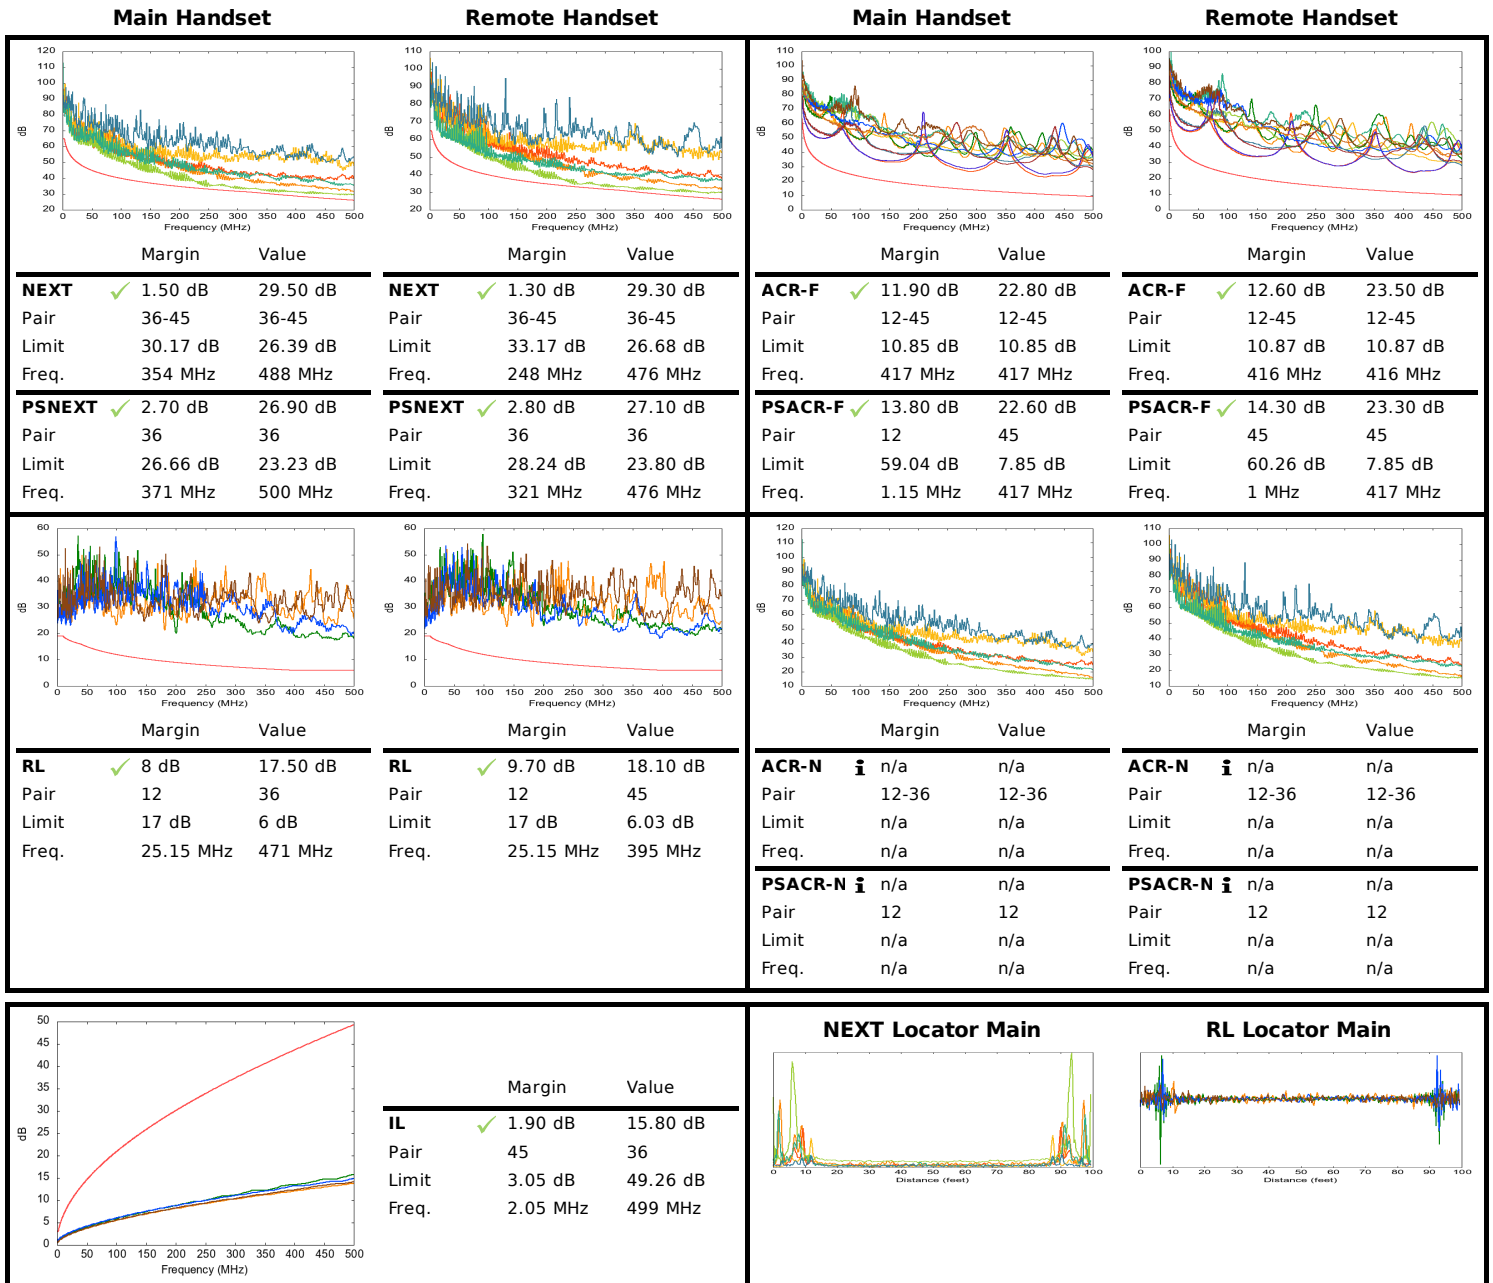

**Test ID:** Remee Cat6A 6UBRD234UTP S45-1700... **Test Standard:** ANSI/TIA-568.2-D-2018  
**Date/Time:** 03/03/2021 03:04 PM **Test Limit:** Channel/Cat6A  
**Project Name:** Simply45\_20210308213839 **Cable Brand/Model:** Generic/Cat6a-UTP  
**Customer Name:** Go Simply Connect **Cable Type/Shield:** Cat6A/UTP  
**Operator:** Default User **Main Connector:** Generic **Remote Connector:** Generic

**Tester Model :** LanTEK IV 3000  
**Main Handset** S/N:19310002 **Remote Handset** S/N:19310002  
 S/W:1.50 S/W:1.50  
**Calibration Date:** 01/01/2021 **Calibration Date:** 01/01/2021  
**Cat 8.1 RJ45 CH :** S/N 19280046 **S/N 19280005**

Low Frequency Tests				Headroom Summary			
Test	Pair	Limit	Result	Margin (dB)	MHz	Pair	Side
Length	12	328' 1" ft	95' 5" ft ✓	NEXT	1.30	248	Remote
Delay	36	555 ns	144 ns ✓	PSNEXT	2.70	371	Main
Skew	36	50 ns	10 ns ✓	RL	8	25.15	Main
Impedance	n/a	n/a	n/a	IL	1.90	2.05	--
Loop Res	45	25 Ω	14.75 Ω i	TCL	-8.30	3.70	Remote
				ELTCTL	2.20	1	Main
DCRU							
Intra-pair	45	0.20 Ω	9.04 Ω i				
P2P	45-78	0.20 Ω	0.95 Ω i				

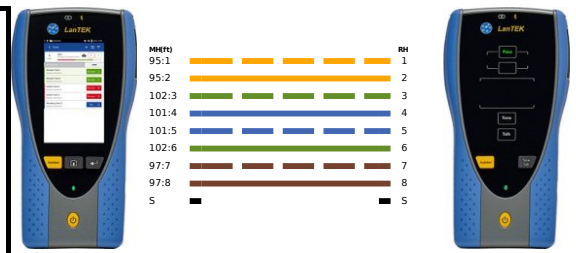

**Supported Applications:**

Ethernet 10BASE-T, ADSL, VDSL, Analog Phone, ATM 25.6, ATM 51.84, ISDN BRI, ISDN PRI, Ethernet 100BASE-TX, Ethernet 1000BASE-T, Ethernet 1000BASE-TX, PoE IEEE 802.3af/at/bt, HDBaseT 1080P, VOIP, ATM 155.52, NBASE-T 2.5G, NBASE-T 5G, HDBaseT 2k, HDBaseT 4k, ATM 1.2G, Ethernet 10GBASE-T

Report Generated 07/27/2021 07:40 PM